



Transnet SOC Limited
T/A Transnet Capital Projects

REQUEST FOR QUOTATION

TFR RME RFQ BOARD
TRANSNET FREIGHT RAIL RME
XXXXXXXXXX
XXXXXXXXXXXX

Registration Number: 1990/000900/06
Vat Number : 4720103177

Attention:
TFR RME RFQ BOARD
Telephone Number :
Fax Number :
Vendor Number :500000

Quotation Deadline Date : 13.08.2013
Quotation Deadline Time : 16H00

REQUEST for QUOTATION
Transnet Capital Projects
RFQ Number / Date
6000169390 / 02.08.2013
Contact Person / Telephone
Anne Mongie / 031 361 1759
Return to VAX Number/EMAIL
0318300001 / TCPtendersDurban@Transnet.net

Item	Material	Description	RFQ Qty	UoM	Required Del date	Confirm Del date	Unit Price Excl	Total Price Excl
00010		Concrete Cable Slabs	500	ea	19.08.2013			

Concrete Cable Slabs as per the attached drawing

Deliver to 130 Eel Rd Bayhead Durban
Contact Brightman 0834642343

QUOTATION DEADLINE : 13 AUGUST 2013 @ 16H00.
PLEASE ATTACH COPIES OF BBBEE AND TAX CLEARANCE CERTIFICATES.

ALL TECHNICAL QUERIES TO BE DIRECTED TO :
BRIGHTMAN ZUNGU ON 0834642343
ALL PROCUREMENT RELATED QUERIES TO BE DIRECTED TO :
ANNE MONGIE ON 031-361 1759
E-MAIL : anne.mongie@transnet.net



REQUEST FOR QUOTATION

Transnet SOC Limited
 T/A Transnet Capital Projects
 TFR RME RFQ BOARD
 TRANSNET FREIGHT RAIL RME
 xxxxxxxxx
 xxxxxxxxxxxx
 0000

Registration Number: 1990/000900/06
 Vat Number : 4720103177

Attention:
 TFR RME RFQ BOARD
 Telephone Number :
 Fax Number :
 Vendor Number :500000

Quotation Deadline Date : 13.08.2013
Quotation Deadline Time : 16H00

REQUEST for QUOTATION
 Transnet Capital Projects
RFQ Number / Date
 6000169390 / 02.08.2013
Contact Person / Telephone
 Anne Mongie / 031 361 1759
Return to VAX Number/EMAIL
 0318300001 / TCPtendersDurban@Transnet.net

Delivery Address

This RFQ is subject to the following conditions:

1. Price/s : The price/s quoted in SA currency and is excluding of V.A.T
2. Delivery : The price/s quoted should include delivery cost to the delivery address stated on the RFQ
3. Returnables : A valid tax clearance certificate and BBBEE certificate from a SANAS accredited verification agency attached to quotation for all quotes above R30 000.
 Please note that only the official Transnet RFQ will be accepted and all other correspondence to be attached to the original
4. Safety : To confirm to Transnet Capital Projects Health & Safety plan and specification; HAS-std-0001, copy available on request.
5. Confirmation: To confirm your participation in this tender process please sign and return this document as immediate effect prior to the quotation deadline.
6. Negotiations: The Employer may elect to negotiate the final terms of the contract/order with the preferred tenderer in accordance with Clauses F.2.17 and F.3.13 of the CIDB Standard Conditions of Tender. A copy of which is available upon request.



 Signature

 Date

"PREVIEW COPY ONLY"

750

65

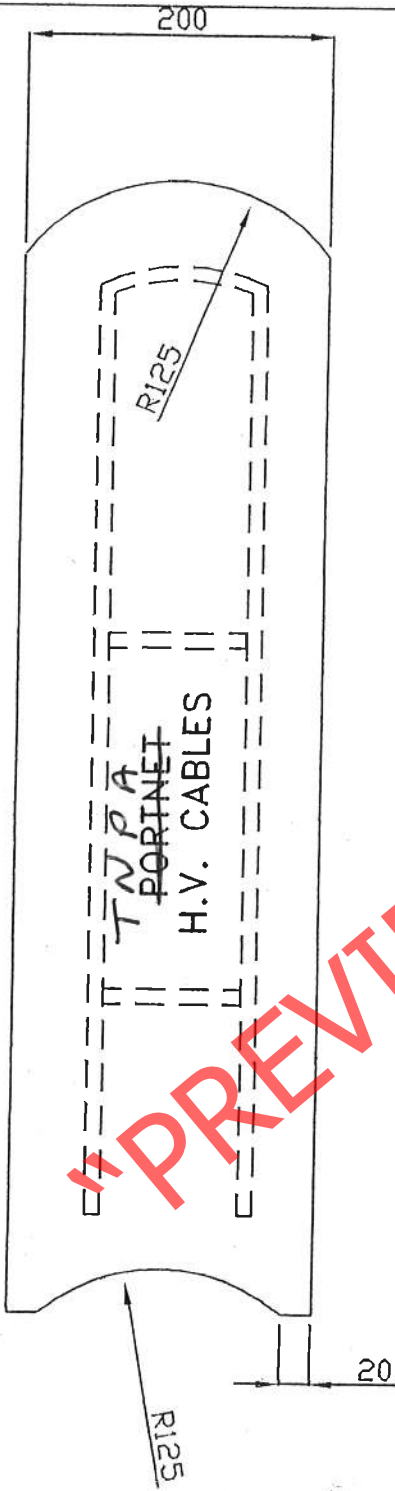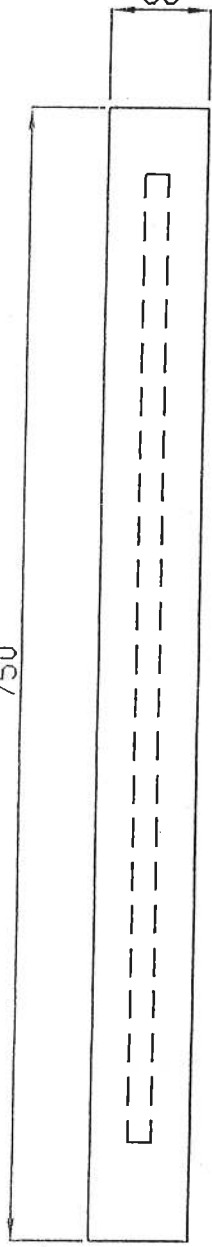

PREVIEW COPY ONLY


NOTES :

1. CABLE PROTECTION SLAB MUST BE CAST USING CONCRETE.
2. LETTERS TO BE PRESSED INTO CONCRETE.
3. MINIMUM STONE SIZE SHOULD BE 12mm .²
4. THE CRUSHING STRENGTH OF THE CONCRETE SHALL NOT BE LESS THAN 20 MPA AT 28 DAYS.
5. SLAB TO BE VIBRATION TEMPERED.
6. WIRE REINFORCING DIAMETER SHALL BE 5mm.
7. TOLERANCES OF DIMENSIONS SHALL BE +/-5mm.
8. COMPACTION, FINISH AND CURING OF THE SLAB SHALL BE TO THE SATISFACTION OF PORTNET TECHNICAL OFFICER.
9. SLAB SHALL BE COLOURED ORANGE OXIDE MIXED INTO CONCRETE
10. 3 X COLOURED SLAB FOR JOINTS AND FOR TURN OUTS.

DR NG

**CABLE PROTECTION
SLAB (OXIDE)**

DRAWN	DATE
SCALE	SHEET
ELECTRICAL DRAWING NO.	
PPD-PA-10	



PROTEKON (PTY) LTD
A SUBSIDIARY OF IRANSHEET LTD
REG. NO. 99/08932/07

EEL ROAD, BAYHEAD
BOX 1073, DURBAN

PROTEKON


KwaZulu-Natal

TEL. 031 3615917
FAX. 031 3615918

750

65

PORTNET ELECTRICAL
H.V. CABLES

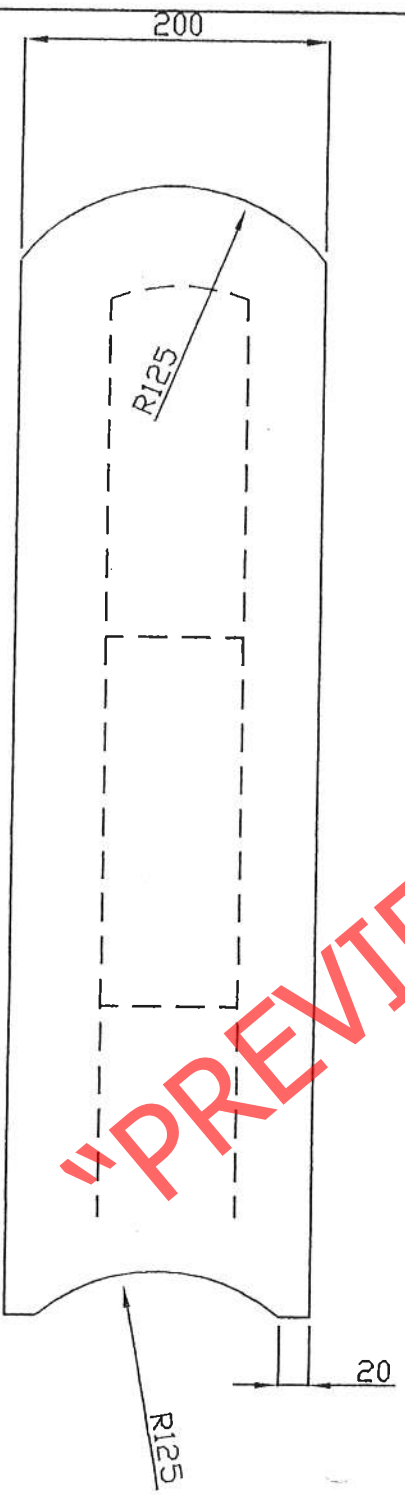

“PREVIEW COPY ONLY”

NOTES :

1. CABLE PROTECTION SLAB MUST BE CAST USING CONCRETE.
2. LETTERS TO BE PRESSED INTO CONCRETE.
3. MINIMUM STONE SIZE SHOULD BE 12mm .²
4. THE CRUSHING STRENGTH OF THE CONCRETE SHALL NOT BE LESS THAN 20 MPA AT 28 DAYS.
5. SLAB TO BE VIBRATION TEMPERED.
6. WIRE REINFORCING DIAMETER SHALL BE 5mm.
7. TOLERANCES OF DIMENSIONS SHALL BE +/-5mm.
8. COMPACTION, FINISH AND CURING OF THE SLAB SHALL BE TO THE SATISFACTION OF PORTNET TECHNICAL OFFICER.
9. SLAB SHALL BE COLOURED ORANGE OXIDE MIXED INTO CONCRETE.

DRA G

CABLE PROTECTION
SLAB

DRAWN	DATE
SCALE	SHEET
ELECTRICAL DRAWING NO. PPD-PA-9	



PROTEKON (PTY) LTD
A SUBSIDIARY OF TRANSNET LTD
REG. NO. 99/08932/07

EEL ROAD, BAYHEAD
BOX 1073, DURBAN

PROTEKON
KwaZulu-Natal

TEL. 031 3615917
FAX. 031 3615918