


RFQ / TENDER

Tender No: VAR-6547



Vendor No: 11001386

BOARD LIST
BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT
2000

Purchaser : Zakhele Nxumalo
Telephone : 011 584 0605
Fax Number : 011 584 1334

Please quote reference:
D55/6000559899

Closing Date : 21.09.2010
Validity Date : 21.12.2010
RFQ No : 6000559899

Item	Qty	Material	Description	
00010	229,312	54016836	NYLON CATENARY DROPPER SADDLE 160MMSQ	R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54016836
APPROVED ITEM NAME INSULATOR,ELECTRICAL CONDUCTOR
DRAWING NUMBER CEE-TND-5 DATE 98-6-4
EQUIPMENT USED ON OHTE
STORES DESCRIPTION DROPPER SADDLE.
SINGLE CATENARY NYLON DROPPER
SADDLE.
FOR CATENARY WIRE 160 MM SQ

00020	203,118	54017312	DROPPER CLIP CONTACT 161 MM SQ	R..... Each
-------	---------	----------	--------------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54017312
APPROVED ITEM NAME CLAMP,ELECTRICAL
DRAWING NUMBER CEE-TND-22SHT1-5 DATE 20.09.2004
BBB 8332 DATE 14-02-2005
SPECIFICATION NUMBER CEE.0063.88/1

DATE: SIGNATURE OF TENDERER(S):
CONTACT PERSON: TEL No:

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 2

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	
EQUIPMENT USED ON STORES DESCRIPTION		OHTE DROPPER CLIP, CONTACT WIRE 161 SQ MM. COPPER-NICKLE-SILICON OR STAINLESS STEEL. COMPLETE WITH M10 30 MM. LONG SCREW AND LOCK WASHER HEAT TREATED.		
TENDERERS TO NOTE : BOTH DESIGNS ARE TECHNICAL ACCEPTABLE.				
00030	101,484	54002790	FERRULES FOR DROPPERS10X01X10MM LONG	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
ITEM NUMBER	54002790			
APPROVED ITEM NAME	SECURING SLEEVE			
DRAWING NUMBER	CEE-TX-79DATE 98-10-25			
EQUIPMENT USED ON	OHTE			
STORES DESCRIPTION	SOLID HARD DRAWN COPPER TUBE 10 MM O.D. X 1 MM WALL THICKNESS. 10 MM LONG.			
00040	7,080,667	54022835	LUG 100 MM SQ HUCKBOLT*	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
ITEM NUMBER	54022835			
APPROVED ITEM NAME	TERMINAL,LUG			
DRAWING NUMBER	CEE-TU-136 DATE 01.02.2008			
EQUIPMENT USED ON	OHTE			
STORES DESCRIPTION	CRIMPING LUG. CABLE SIZE 100 SQ MM			
00050	64,308	54020824	BOND KIT WAM TYPE	R..... Each
Delivery Date: 21.12.2010				

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 3

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54020824
APPROVED ITEM NAME KIT,RAIL BOND
PARTNUMBER CD 005-09-19-01R WAM
EQUIPMENT USED ON OHTE
SPECIFICATION BBB6017 VERSION 2
BBC1678 VERSION 1
STORES DESCRIPTION RAIL BOND CONNECTOR
WEDGE TYPE. 13,5 MM.
TO QUOTED PARTNUMBER.

00060 27,082 54017110 LUG 120 MMSQ HUCKBOLT*

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54017110
APPROVED ITEM NAME TERMINAL,LUG
DRAWING NUMBER CEE-TU-136 DATE 01.02.2008
EQUIPMENT USED ON OHTE
STORES DESCRIPTION CRIMPING LUG.
CABLE SIZE 120 SQ MM

00070 25,730 54020848 MAST BOND KIT WAM TYPE UC & I BEAM

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54020848
APPROVED ITEM NAME KIT,MAST BOND
PARTNUMBER CD 005-09-19-02M WAM
EQUIPMENT USED ON OHTE
SPECIFICATION BBB6017 VERSION 2
BBC1678 VERSION 1
STORES DESCRIPTION MAST BOND CONNECTOR
WEDGE TYPE. 13,5 MM.
TO QUOTED PARTNUMBER.

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 5

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
BRAZZ) WITH SPECIFICATIONS CEE 0063.88/1.FOR TESTING METHOD BS EN 12163, BS EN 12164 AND BS EN 12167.ALSO WITH ISO 6509 , SANS 226/LATEST; EQUIPMENT USED ON OHTE DRAWING NO: REV , CEE-TNB-56 DATE 20.04.2009 REV 4, CEE-TNB-57 DATE 28.04.2009 REV 3			
00110	16,500	54032387	CLAMP ELCT;BI-MTL 160-160 PERM,3 KV,ALUM
			R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

CLAMP, ELECTRICAL
 CLAMP TYPE BI-METAL 160-160 PERMANENT
 VOLTAGE RATING 3 KV
 CLAMP MATERIAL ALUMINIUM
 FURNISHED ITEMS INSERT COPPER
 PARALLEL CLAMP, ALUMINIUM GRADE 6063 WITH A PERMANENT FORGED
 COPPER INSERT.
 DRAWING NO: CEE-TNB-94 DATE 17.04.2007 REV 3, CEE-TNB-95 DATE
 17.04.2007 REV 3

00120	13,068	54000754	SPLICE CONDCTR;CONTACT WIRE,DIA 161 MM2
			R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

SPLICE, CONDUCTOR
 TYPE CONTACT WIRE
 DIMENSIONS DIA 161 MM2
 MATERIAL COPPER-NICKEL-SILICON
 P/N: UNKNOWN WAM METALS (PTY) LTD
 MATERIAL NUMBER; 054000754; EQUIPMENT USED ON OHTE ; 25 EACH
 PER CARTOON
 SPECIFICATION: CEE-0063.88/1
 DRAWING NO: CEE-TNB 21 DATE 2002.05.29 REV 2, CEE-TNB 22 DATE
 2009.08.07 REV 4, CEE-TNB 23 DATE 2002.05.29 REV 2

00130	12,546	54006787	DROPPER CLIP FOR 107MMSQ CONTACT WIRE
			R..... Each

Delivery Date: 21.12.2010

DATE: SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 6

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54006787
 APPROVED ITEM NAME CLAMP, ELECTRICAL
 DRAWING NUMBER CEE-TND-22 SH1-5 DATE 13.2.2007
 BBB 8332 DATE 14-02-2005
 SPECIFICATION CEE. 0063.88/1
 EQUIPMENT USED ON OHTE
 DESCRIPTION STORES DROPPER CLIP.
 107 SQ MM.
 COPPER-NICKEL-SILICON OR
 STAINLESS STEEL.
 TENDERERS TO NOTE : BOTH DESIGNS ARE
 TECHNICAL ACCEPTABLE.

00140	9,630	54016925	CLAMP ELCT;BI-MTL 800-160 PERM,3 KV
-------	-------	----------	-------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

CLAMP, ELECTRICAL
 CLAMP TYPE BI-METAL 800-160 PERMANENT
 VOLTAGE RATING 3 KV
 CURRENT RATING 1.631 KA
 CLAMP MATERIAL ALUMINIUM
 FURNISHED ITEMS INSERT COPPER
 P/N: UNKNOWN WAM METALS (PTY) LTD
 USED ON OHTE FCC CONNECTIONS
 DRAWING NO: CEE-TNB-0093 REV 2

00150	9,270.000	54033089	CABLE PWR ELEC;BUNDLE CONDUCTOR,11 KV
-------	-----------	----------	---------------------------------------

R.....
Meter

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

CABLE, POWER, ELECTRICAL
 TYPE BUNDLE CONDUCTOR
 VOLTAGE RATING 11 KV
 PACKAGE TYPE WOOD DRUM 500 M
 CONDUCTOR SIZE 50 MM2
 CORE QUANTITY 3
 FEATURES ALLUMINIUM CONDUCTORS
 P/N: UNKNOWN PH MARKETING CC

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 7

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

TYPE B ,BBC7613 VERSION 2; USED ON OHTE;; 50MM2 G.S.W CATENARY
XLPE INSULATED ; USERS INTEREST:RETICULATION UNDER BRIDGES ETC
SPECIFICATION: SANS1339(ADAPTED), SANS1713

00160	8,826	54002753	SPLICE CONDCTR;PARALLEL CLAMP
-------	-------	----------	-------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

SPLICE, CONDUCTOR
TYPE PARALLEL CLAMP
DIMENSIONS 160 TO 100/80 MM2
MATERIAL COPPER/NICKEL/SILICON
P/N: UNKNOWN WAM METALS (PTY) LTD
ALTERNATIVE MATERIAL DEZINCIFICATION RESISTANT BRASS (D.Z.R.
BRASS) TO BE TESTED IN ACCORDANCE WITH SPECIFICATIONS SANS 226
(LATEST),ISO 6509 (TEST METHOD) BS EN12163, BS EN 12164 ,BE EN
12167 AND CEE.0063.88/1
DRAWING NO: REV , CEE-TNB-54 DATE 20.04.2009 REV 4, CEE-TNB-55
DATE 20.04.2009 REV 4

00170	8,328	54016937	CLAMP ELCT;BI-METAL 500-160 PERM,3 KV
-------	-------	----------	---------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

CLAMP, ELECTRICAL
CLAMP TYPE BI-METAL 500-160 PERM
VOLTAGE RATING 3 KV
CURRENT RATING 1.631 KA
CLAMP MATERIAL ALUMINIUM
SPECIAL FEATURES PARALLEL; PERMANENT INSERT COPPER FORGED
CONDUCTOR SIZE 500 TO 160 MM2
USED ON OHTE FOR F.C.C. FOR 500 SQUARE MM ALUMINIUM #TO 160
SQUARE MM COPPER WIRE
DRAWING NO: CEE-TNB-0096 AMENDMENT REV 2

00180	8,278	54023687	RAIL BOND KIT DE BUIS TYPE 13,5 MM
-------	-------	----------	------------------------------------

R.....
Each

Delivery Date: 21.12.2010

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 8

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54023687
APPROVED ITEM NAME KIT,RAIL BOND
PARTNUMBER 30951 PERMATOOL
EQUIPMENT USED ON OHTE
SPECIFICATION BBB6017 VERSION 2
BBC1678 VERSION 1
STORES DESCRIPTION RAIL BOND KIT
D 13,5-M10 STAINLESS STEEL
COMPLETE WITH SELF LOCKING
NUT AND CRIMPING RING
DIA. 22 MM. BUSH.
TO QUOTED PARTNUMBER ONLY.

00190	8,060	54032476	INSULATOR;TENSION,25 KVAC,SILICON RUBBER	R..... Each
-------	-------	----------	--	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

INSULATOR
TYPE TENSION
POTENTIAL 25 KVAC
MATERIAL SILICON RUBBER
P/N: UNKNOWN ELECTRICAL MOULDED COMPONENTS
REV 4; CREEPAGE PATH OF 1476 MM; ITEM NUMBER 54032476; VANDAL
PROOF ATTACHMENT FITTING ROUND TONGUE AND ROUND CLEVIS END
CAPS (COMPOSITE)
SPECIFICATION: IEC 1109
DRAWING NO: BBB0281 REV 4

00200	5,610	54004020	CLEVIS PIN 16X60MM LONG WITH SPLITPIN	R..... Each
-------	-------	----------	---------------------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54004020
APPROVED ITEM NAME PIN,STRAIGHT,HEADED
DRAWING NUMBER CEE-TX-66 DATE 98-8-4
SPECIFICATION SANS 121 DATE 2000
EQUIPMENT USED ON OHTE
STORES DESCRIPTION CLEVIS PIN
STEEL

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 10

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

TERMINAL, LUG
TYPE: RING
WIRE SIZE ACCOMMODATED: 160 MM2
DIMENSIONS: M14.5
P/N: UNKNOWN COPPER CABLES & CONNECTORS(PTY)LTD
EQUIPMENT USED ON OHTE; CABLE SIZE CLEARANCE HOLE; FOR STUD
CRIMPING; STUD M12
DRAWING NO: CEE-TNB - 58 DATE 1996.08.01 REV 0, CEE-TU-0136
DATE 04.06.2007 REV 0, CEE-TU-136 DATE 01-02-2008 REV 0

00240	3,628	54031661	LINER SET FOR DOUBLE SUSPENSION CLAMP
-------	-------	----------	---------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

APPROVED ITEM NAME LINER, EXPENDABLE METAL
DRAWING NUMBER CEE-TNB-88
EQUIPMENT USED ON O.H.T.E
SPECIFICATION NUMBER B.S 1470 GRADE SIC CON.0
STORES DESCRIPTION LINER SET ALUMINIUM
SET TO CONSIST OF A UPPER AND
LOWER LINER TO QUOTED DRAWING.
TO BE USED WITH DOUBLE SUSPENSION
CLAMP 54/4917

00250	3,506	54017122	LUG 150 MM SQ HUCKBOLT*
-------	-------	----------	-------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54017122
APPROVED ITEM NAME TERMINAL,LUG
DRAWING NUMBER CEE-TU-136 DATE 01.02.2008
EQUIPMENT USED ON OHTE
STORES DESCRIPTION CRIMPING LUG.
CABLE SIZE 150 SQ MM

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 11

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
00260	3,416	54000438	BUSH METRIC FOR MAST BASE INSULATION*

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54000438
APPROVED ITEM NAME INSULATION SLEEVING,ELECTRICAL
DRAWING NUMBER CEE-TU-143SHT4 DATE16-11.2000
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER CEE.0166.96
STORES DESCRIPTION SLEEVING, INSULATION.
MAST BASE INSULATION BUSH
RESIN BONDED TUBING. 38 MM ID
X 43 MM OD X 23 MM WIDE.

00270	3,390	54000414	WASHER METRIC MAST BASE INSULATION*
-------	-------	----------	-------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 054000414
APPROVED ITEM NAME INSULATION,WASHER
DRAWING NUMBER CEE-TU-143SHT3 DATE16-11.2000
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER CEE.0166.96
STORES DESCRIPTION WASHER, INSULATION.
MAST BASE INSULATION WASHER.
ROUND GLASS FIBRE FABRIC,
SUITABLE BONDED WITH SYNTHETIC
RESIN. 44 MM ID X 76 MM OD X
4 MM THICK.

00280	3,208	54016848	NYLON CATENARY DROPPER SADDLE 250MMSO
-------	-------	----------	---------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54016848
APPROVED ITEM NAME INSULATOR,ELECTRICAL CONDUCTOR

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 12

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	
DRAWING NUMBER CEE-TND-5 DATE 98-6-4				
EQUIPMENT USED ON OHTE				
STORES DESCRIPTION DROPPER SADDLE. SINGLE CATENARY NYLON DROPPER SADDLE. FOR CATENARY WIRE 250 MM SQ				
00290	3,050	54032504	CLAMP ELEC CONDUCT STRN; GRADE 6063	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
CLAMP, ELECTRICAL CONDUCTOR, STRAIN TYPE: GRADE 6063 CLAMP TYPE: PARALLEL P/N: UNKNOWN WAM METALS (PTY) LTD PARALLEL; ALUMINIUM, SQ 160 MM, GRADE 6063 DRAWING NO: BBB0376 REV 3, BBB0377 REV 3				
00300	2,876	54000690	CLAMP;SWIVEL CLIP ASSY,DIA 161 MM2	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
CLAMP TYPE SWIVEL CLIP ASSEMBLY DIMENSIONS DIA 161 MM2 MATERIAL COPPER-NICKEL SILICON P/N: UNKNOWN QUALITY ENHANCEMENT TECHNOLOGY MATERIAL NUMBER 054000690, EQUIPMENT USED ON OHTE, FOR CHEEKS ONLY SEE 54033583 SPECIFICATION: CEE.0063.88/1 DRAWING NO: CEE-TN-330 DATE 2003.11.26 REV 0, CEE-TND-035 DATE 2003.11.26 REV 0, CEE-TND-1 DATE 2003.11.26 REV 0				
00310	2,754	54024883	LINE POST INSULATOR 11 KV SILICON (PIN)	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				

DATE: SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 13

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
ITEM NUMBER	54024883		
APPROVED ITEM NAME	INSULATOR,LINE POST		
MATERIAL USED ON	OHTE		
MAKERS PARTNUMBER	145 001-009 SEFAG		
DESCRIPTION	CPIN 12 CIP		
	LINE POST INSULATOR		
	11 KV. AC. SILICON		
	TO INCLUDE M20 X 155 MM		
	LONG FULL THREAD ROD,NUT		
	AND FLAT WASHER.		
	GALVANISED TO SPEC. EN ISO 1461.		
00320	2,628	54002171	EXTENSION/LINK STRAP 120X50X6MM THICK
			R..... Each
Delivery Date: 21.12.2010			
FULL DETAILS OF DESCRIPTION			
ITEM NUMBER	54002171		
APPROVED ITEM NAME	ADAPTER PLATE		
DRAWING NUMBER	CEE-TNE-033 DATE 11-09-1995		
EQUIPMENT USED ON	5405201		
STORES DESCRIPTION	ADAPTER PLATE.		
	EXTENSION AND LINK STRAP		
	GALVANISED FLAT IRON (M.S.)		
	120 MM X 50 MM X 6 MM THICK.		
00330	2,614	54016897	STRAIN INSULATOR VANDAL PROOF 3KV
			R..... Each
Delivery Date: 21.12.2010			
FULL DETAILS OF DESCRIPTION			
MATERIAL NUMBER	054016897		
APPROVED ITEM NAME	INSULATOR, STRAIN		
DRAWING NUMBER	CEE-TNC-4 DATE 99-04-28		
EQUIPMENT USED ON	3 KV. OHTE		
MAKERS PART NUMBER	DS-15S MACE		
STORES DESCRIPTION	STRAIN INSULATOR.		
	VANDAL PROOF 3KV.DC.		
	TONGUE AND CLEVIS TYPE.		
	TO QUOTED PARTNUMBER OR EQUAL,		
	AND MUST COMPLY TO QUOTED DRAWING		

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 14

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

00340	2,500	54033319	LUG 120 MM SQ M16*
-------	-------	----------	--------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 054033319
APPROVED ITEM NAME TERMINAL,LUG
STORES DESCRIPTION CRIMPING LUG
CABLE SIZE 120 MM SQ
CLEARANCE HOLE FOR STUD M16
COMMERCIAL QUALITY.COPPER TUBING
TO B.S. 2871, COLD FORMED
IN ACCORDANCE STAMCOR DIMENSION
CHART.

00350	2,326	54032541	INSULATOR STDOF; VANDAL PROOF, 25 KVAC
-------	-------	----------	--

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

INSULATOR, STANDOFF
TYPE VANDAL PROOF
INSULATOR MATERIAL SILICON RUBBER
VOLTAGE RATING 25 KVAC
INSULATOR ATTACHMENT METHOD SQUARE TONGUE AND CLEVIS END
SPECIAL FEATURES CREEPAGE PATH 1476 MM
P/N: UNKNOWN ELECTRICAL MOULDED COMPONENTS
ITEM NUMBER 54032541
DRAWING NO: BBB0429 REV 4, BBB0430 REV 3

00360	2,310	54032375	CLAMP ELCT;BI-METAL 160-100/80 PERMANENT
-------	-------	----------	--

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

CLAMP, ELECTRICAL
CLAMP TYPE BI-METAL 160-100/80 PERMANENT
VOLTAGE RATING 3 KV
CLAMP MATERIAL ALUMINIUM GRADE 6063

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 16

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
			TO BE TESTED IN ACCORDANCE WITH SPECIFICATION BS 2874 OF 1986 (LATEST) TO CLAUSE 8 AND APPENDIX "G" ALSO SPECIFICATIONS S.A.B.S. 226 I.S.O. 6509 (TEST METHOD)

00390	1,590	54003823	SPLIT PIN 6,3MM DIA X 56MM NOMINAL LENGTH R..... Each
-------	-------	----------	---

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54003823
APPROVED ITEM NAME PIN,COTTER
SPECIFICATION NUMBER SANS 1700-17-1
STORES DESCRIPTION SPLIT PIN
6,3 MM DIA X 56 MM
NOMINAL LENGTH.
BRASS

00400	1,446	54009298	HOCKEY STICK STAINL. 25,4MM OD. 3 KV R..... Each
-------	-------	----------	--

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54009298
APPROVED ITEM NAME HOCKEY STICK
DRAWING NUMBER CEE-TND-20
STORES DESCRIPTION HOCKEY STICK.
PULL OFF HOCKEY STICK.
OD = 25.4 MM.TOLERANCE +0-0.75.
WALL THICKNESS = 2 MM MINIMUM
AFTER MANIPULATION.
HARDNESS = 180-270 BRINELL.
ELONGATION = 6 % MINIMUM ON
25.4 MM GAUGE LENGTH AT 0.02 %
OFFSET. ULTIMATE TENSILE
STRESS = 486 N/MM SQ. MINIMUM.
MATERIAL = AISI 304 WELDED.

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 17

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

00410	1,406	54031713	INSULATOR; PAD; I-BEAM/UC MASTBASES	R..... Each
-------	-------	----------	-------------------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

INSULATOR
TYPE: PAD; I-BEAM/UC MASTBASES
POTENTIAL: 450 V
DIMENSIONS: WID 160 X LG 435 X THK 2.5 MM
MATERIAL: FABRIC WOVEN, SYNTHETIC RESIN BONDED GLASS FIBER
MATERIAL TO BE EQUAL TO SPECIFICATION BS 3396 AND APPROVED BY
TRANSNET FREIGHT RAIL.#USED ON OHTE MAST BASE ANTI-ELECTROLYSIS
ARRANGEMENT. #ITEM NUMBER 54031713.
SPECIFICATION: CEE.0166
DRAWING NO: CEE-TU-143 SHT 2 OF 4 REV 3

00420	1,400	54003783	SPLIT PIN 6,3MM DIA X 80MM NOMINAL LENGTH	R..... Each
-------	-------	----------	---	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54003783
APPROVED ITEM NAME PIN,COTTER
SPECIFICATION NUMBER SANS 1700-17-1
STORES DESCRIPTION SPLIT PIN
 6,3 MM DIA X 80 MM
 NOMINAL LENGTH.
 BRASS.


00430	1,380	54004917	DOUBLE SUSPENSION CLAMP	R..... Each
-------	-------	----------	-------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54004917
APPROVED ITEM NAME CLAMP,SUSPENSION
DRAWING NUMBER CEE-TNB-074
EQUIPMENT USED ON OHTE
STORES DESCRIPTION DOUBLE SUSPENSION CLAMP
 SUITABLE FOR USE ON

DATE: SIGNATURE OF TENDERER(S):

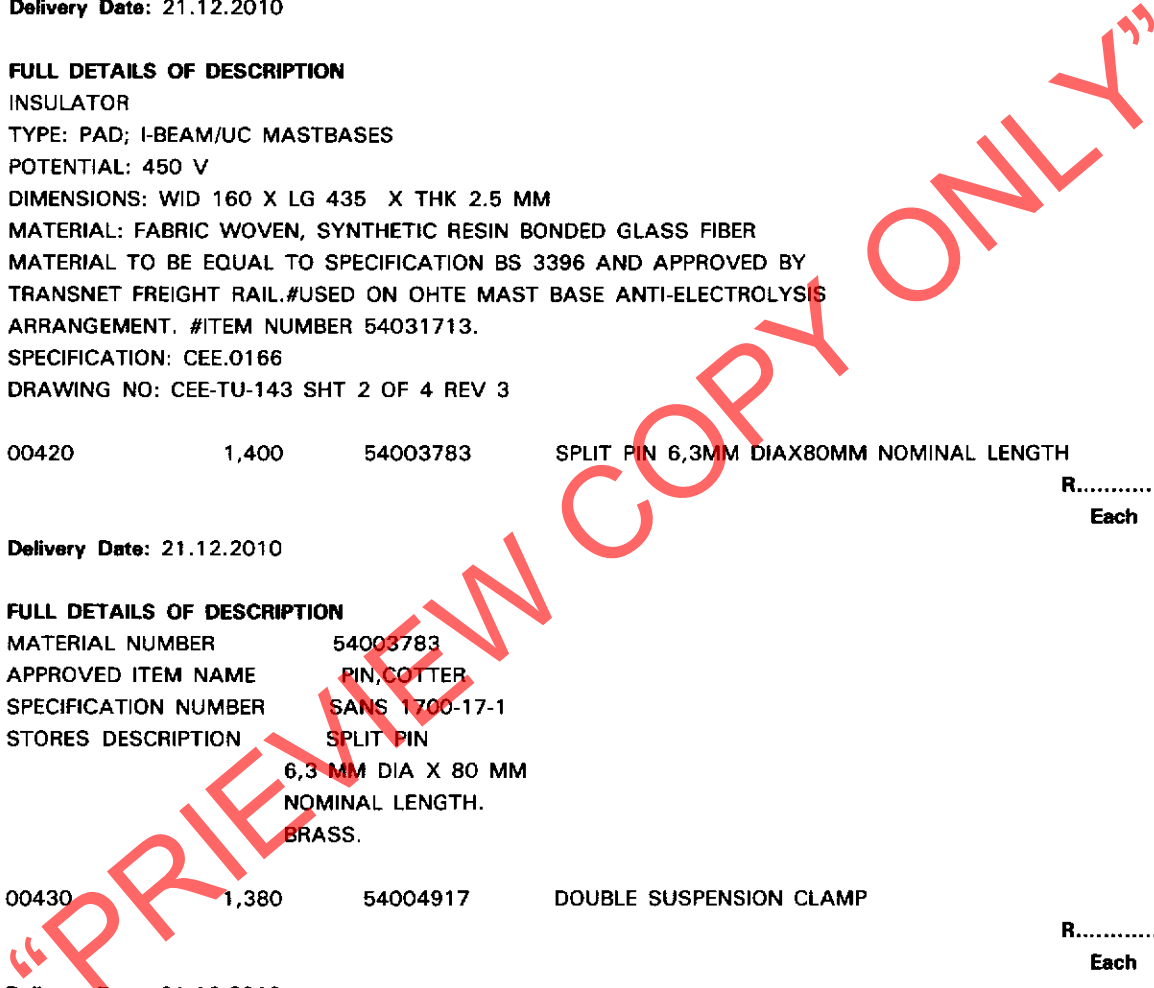

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 18

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
		80-250 MM SQ. STRANDED COPPER CATENARY AND 500-800 MM SQ. STRANDED ALUMINIUM FEEDER WIRE	

00440 1,354 54001937 TURNBUCKLE FOR SECTION INSULATOR

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54001937
APPROVED ITEM NAME TURNBUCKLE
DRAWING NUMBER CEE-TNB-032 DATE 1995-04-26
EQUIPMENT USED ON OHTE
STORES DESCRIPTION TURNBUCKLE
CU-NI-SI OR STAINLESS STEEL
TAKE-UP: 90 MM FOR STAINLESS
STEEL AND 75 MM FOR CU-NI-SI.
QUOTED DRAWING FOR CU-NI-SI
ONLY.

00450 1,310 54009314 STEADY ARM STAINLESS CURVED

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54009314
APPROVED ITEM NAME STEADY ARM
DRAWING NUMBER CEE-TND-019
STORES DESCRIPTION STEADY ARM.
CURVED STEADY ARM.
OD = 25.4 MM.TOLERANCE+0-0.75.
WALL THICKNESS = 2 MM MINIMUM
AFTER MANIPULATION.
HARDNESS = 180-270 BRINELL.
ELONGATION = 6 % MINIMUM ON
25.4 MM GAUGE LENGTH AT 0.02 %
OFFSET. ULTIMATE TENSILE
STRESS = 486 N/MM SQ. MINIMUM.
MATERIAL = AISI 304 WELDED.

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 19

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

00460	1,220	54000717	PREF. SPIRAL SPLICE 80MMSQ CU CATENARY
-------	-------	----------	--

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

APPROVED ITEM NAME SPLICE, CONDUCTOR
EQUIPMENT USED ON OVERHEAD TRACK CONDUCTOR
MAKERS PART NUMBER CLS 443 P.L.P.
STORES DESCRIPTION PREFORMED SPIRAL SPLICE,
SUITABLE FOR USE ON
80 SQ MM (7/3,75 MM
STRANDING) COPPER CATENARY WIRE
TO QUOTED PART NUMBER OR EQUAL

00470	1,190	54009096	PREF. SPLICE FOR TIGERWIRE 160MMSQ ACSR
-------	-------	----------	---

R.....
Set

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 054009096
APPROVED ITEM NAME SPLICE, CONDUCTOR
EQUIPMENT USED ON OHTE
MAKERS PART NUMBER ALS FT 651 DULMISON
STORES DESCRIPTION PRE-FORMED LINE SPLICE
SUITABLE FOR USE ON
131,23/30,62 SQ MM. "TIGER".
30/7/2,36 STRANDING ACSR WIRE
DIA 16,52 MM.
COLOUR CODE RED.
TO QUOTED PART NUMBER OR EQUAL

00480	1,074	54004816	EGG INSULATOR 44MM HOLE CENTRES
-------	-------	----------	---------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

APPROVED ITEM NAME INSULATOR, STRAIN
EQUIPMENT USED ON 5405001

DATE: SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 20

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
MAKERS PART NUMBER		21-1354 ELC	
		21-1354 SAG	
STORES DESCRIPTION		INSULATOR, STRAIN. GLAZED PORCELAIN HOLE CENTRES 44 MM TO QOUTED PART NUMBER OR EQUAL	
00490	990	54011226	SUSP.INSULATOR SQUARE TONGUE/CLEVIS25 KV R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54011226
APPROVED ITEM NAME INSULATOR,SUSPENSION
DRAWING NUMBER CEE-TNC-20/LATEST
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER SANS 60383 PART 1
STORES DESCRIPTION INSULATOR, SUSPENSION.
PORCELAIN.
SOLID CORE WITH TONGUE AND
CLEVIS CAPS.

00500 930 54010107 RAIL BOND 610MM LONGX35MMSQ COMPOSITE*
R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54010107
APPROVED ITEM NAME LEAD,ELECTRICAL
EQUIPMENT USED ON OHTE
STORES DESCRIPTION RAIL BOND. COMPOSITE
610 MM LONG X 35 SQ MM.
COMPOSITE STEEL AND COPPER
EXOTHERMIC RAIL BOND COMPLETE
WITH COPPER FERRULES.
35 SQ MM COPPER EQUIVALENT.
MAKE UP AND STRANDING 7 ROPES:
1 OF 19/0,85 COPPER (INNER)
6 OF 19/0,85 (7 COPPER INNER)
12 STEEL OUTER.

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 22

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	R.....
AND ISO 6509 (TEST METHOD).CEE.0063.88/1. EQUIPMENT USED ON :OHTE DRAWING NO: REV , CEE-TNB-56 DATE 20.04.2009 REV 4, CEE-TNB-57 DATE 17.04.2007 REV 0, CEE-TNB-57 DATE 1996.08.01 REV 0, CEE-TNB-57 DATE 28.04.2009 REV 3				
00540	820	54031697	TERMINAL LUG;CRIMPING,95 MM2,CU,TIND	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION TERMINAL, LUG TYPE CRIMPING WIRE SIZE ACCOMMODATED 95 MM2 TERMINAL MATERIAL COPPER HOLE QUANTITY 1 TERMINAL FINISH TINNED FEATURES M16 STUD FURNISHED ITEMS COLD FORMED P/N: UNKNOWN HHH MANUFACTURING (PTY) LTD TO STONE STAMCOR ELECTRIC DIMENSION CHART; STANDARD SPECIFICATION: B.S.2871				
00550	746	54032363	CLAMP ELCT;BI-METAL 160-50 PERMANENT	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION CLAMP, ELECTRICAL CLAMP TYPE BI-METAL 160-50 PERMANENT VOLTAGE RATING 3 KV CLAMP MATERIAL ALUMINIUM FURNISHED ITEMS INSERT COPPER P/N: UNKNOWN WAM METALS (PTY) LTD PARALLEL, GRADE 6063 DRAWING NO: CEE-TNB-94 DATE 17.04.2007 REV 3, CEE-TNB-95 DATE 17.04.2007 REV 3				
00560	724	54032516	INSULATOR STD0F; VANDAL PROOF, 25 KVAC	R..... Each
Delivery Date: 21.12.2010				

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 23

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

INSULATOR, STANDOFF
TYPE VANDAL PROOF
INSULATOR MATERIAL SILICON RUBBER
VOLTAGE RATING 25 KVAC
INSULATOR ATTACHMENT METHOD ROUND TONGUE AND SPADE FITTING
SPECIAL FEATURES CREEPAGE PATH 1476 MM
P/N: UNKNOWN ELECTRICAL MOULDED COMPONENTS
DRAWING NO: BBB0429 REV 4, BBB0430 REV 3

00570	696	54032553	INSULATOR STD0F; VANDAL PROOF, 25 KVAC	R..... Each
-------	-----	----------	--	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

INSULATOR, STANDOFF
TYPE VANDAL PROOF
INSULATOR MATERIAL SILICON RUBBER
VOLTAGE RATING 25 KVAC
INSULATOR ATTACHMENT METHOD CLEVIS/SPADE FITTING
FOR COMPRESSED CONDITIONS WITH CREEPAGE PATH OF 1476 MM
DRAWING NO: BBB0429 REV 4, BBB0430 REV 3

00580	682	54001177	DISCINSULATOR PORC. CLEVIS/TONGUE 11 KV*	R..... Each
-------	-----	----------	--	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54001177
APPROVED ITEM NAME INSULATOR,SUSPENSION
DRAWING NUMBER BBB1158 VERSION 1
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER SANS 60383 PART 1
STORES DESCRIPTION INSULATOR, SUSPENSION.
CERAMIC/GLASS TYPE U70/CL
WITH ZINC COLLAR,CLASS B
CLEVIS AND TONGUE WITH LIMITED
MOVEMENT.

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 24

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	
00590	660	54001533	SUSP.CLAMP FOR 11TO 21 MM DIA. CAT. WIRE	R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54001533
APPROVED ITEM NAME CLAMP,SUSPENSION
DRAWING NUMBER CEE-TNB-073
EQUIPMENT USED ON OHTE
STORES DESCRIPTION CLAMP, SUSPENSION
WITH TIE-DOWN FACILITY, FOR
80-250 SQ MM STRANDED COPPER
CATENARY WIRE.
(11,25 TO 21 MM. DIA. WIRE)

00600	614	54006827	CONTACT SPLICE107/CONTACTWIRE*	R..... Each
-------	-----	----------	--------------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54006827
APPROVED ITEM NAME SPLICE,CONDUCTOR
DRAWING NUMBER CEE-TN-404 DATE 2006.09.27
CEE-TN-405 DATE 2002.01.15
CEE-TN-406 DATE 2006.09.27
CEE-TN-407 DATE 2002.01.15
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER CEE.0063.88/1.
STORES DESCRIPTION SPLICE, CONDUCTOR.
107 MM SQ. CONTACT WIRE

00610	612	54016901	JOINTING COMPOUND FOR ALI. CONNECTIONS	R..... Each
-------	-----	----------	--	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 054016901
APPROVED ITEM NAME JOINTING COMPOUND,ELECTRICAL
STORES DESCRIPTION JOINTING COMPOUND, ELECTRICAL.

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 25

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	R.....
			OXIDATION INHIBITING. FOR ALUMINIUM CONNECTIONS. SUPPLIED IN 1 KG TINS. "DENSO"ELECTRICAL JOINTING COMPOUND, OR EQUAL.	
TENDERER TO NOTE :				
			EACH TIN TO BE MARKED WITH THE FOLLOWING WORDING: ELECTRICAL JOINTING COMPOUND. OXIDATION INHIBITING. USE BETWEEN ALUMINIUM OR BI-METAL CONNECTIONS ONLY. (STORES ITEM =54/16901).	
00620	552	54021980	SINGLE SUSPENSION CLAMP 500-800 MMSQ.	Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54021980
APPROVED ITEM NAME CLAMP,SUSPENSION
DRAWING NUMBER CEE-TNB-91 SHEETS 1 TO 6
STORES DESCRIPTION SUSPENSION CLAMP
SINGLE GALVANISED MALLEABLE
CAST IRON SUITABLE FOR USE ON
500 - 800 MM SQ.
STRANDED ALUMINIUM FEEDER WIRE

00630	552	54028819	SWIVEL CLIP ASSEMBLY 107 MM SQ 50 KV AC	R..... Each
-------	-----	----------	---	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54028819
APPROVED ITEM NAME: CLAMP, ELECTRICAL
DESCRIPTION STORES: SWIVEL CLIP ASSEMBLY
107 SQ MM
COPPER NICKEL SILICON
SPECIFICATIONS: CEE 0063 8/1.
DRAWING NUMBER: CEE-TND-37 SH 1 DATE 1997.06.25
CEE-TND-37 SH 2 DATE 2000.06.27
EQUIPMENT USED ON: Ohte

DATE: SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 26

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	
SISHEN-SALDANAH				
00640	542.000	54033712	FIBRE ROPE 20 MM. +-139M/25KG	R..... Kilogram

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54033712
APPROVED ITEM NAME ROPE,FIBROUS
EQUIPMENT USED ON OHTE
STORES DESCRIPTION FIBRE ROPE 20 MM
3 STRAND.POLYPROPYLENE.
BRICK SYN. P.P. SPLITFILM-STK.
MIN. BREAKING STRENGTH 51 KN.
TO BE SUPPLIED IN 25 KG COILS.

00650	530	54010512	RAIL BOND 220MM LONGX100MMSQ COPPER	R..... Each
-------	-----	----------	-------------------------------------	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

APPROVED ITEM NAME LEAD,ELECTRICAL
DRAWING NUMBER CEE-TU-53/LATEST
EQUIPMENT USED ON 5400000
5405700
5405701
STORES DESCRIPTION RAIL BOND.
220 MM LONG X 100 MM SQ.
ANNEALED COPPER CONDUCTOR
COMPLETE WITH FERRULES.

00660	518	54007618	INSULATORSTANDOFFSQ TONGUE/PIPE CAP 25KV	R..... Each
-------	-----	----------	--	----------------

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54007618
APPROVED ITEM NAME INSULATOR,STANDOFF
DRAWING NUMBER CEE-TNC-21/LATEST
SPECIFICATION NUMBER SANS 60383 PART 1

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 27

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

STORES DESCRIPTION INSULATOR, STANDOFF.
SOLID CORE INSULATOR WITH
SQ TONGUE AND PIPE CAP.

00670 482 54001027 LUG ALI 800MMSQ DEAD END

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

APPROVED ITEM NAME TERMINAL,LUG
DRAWING NUMBER CEE-TNB-27
EQUIPMENT USED ON DEAD END STRAIN CLAMP
SPECIFICATION NUMBER CEE. 0038/LATEST
STORES DESCRIPTION LUG, CRIMPING.
CABLE SIZE 800 SQ MM
SUITABLE FOR 800 SQ MM
STRANDED ALUMINIUM WIRE.
COMPLETE WITH BOLTS AND NUTS.

00680 482 54004764 PISTOL GRIP 8 TO 18 MM DIA CU WIRE

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 054004764
APPROVED ITEM NAME CLAMP,ELECTRICAL CONDUCTOR,STR
AIN
EQUIPMENT USED ON OHTE
MAKERS PART NUMBER ST 8 - 18
SPECIFICATION NUMBER T-T10A-19.
STORES DESCRIPTION CATENARY WIRE STRAIN CLAMP FOR
80 - 160 SQ MM, MIN DIA: 8 MM
MAX DIA: 18 MM.
3 U BOLTS
STRANDED COPPER AND ALUMINIUM
CONDUCTORS

USERS DESCRIPTION OVERHEAD TRACK EQUIPMENT

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 28

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
00690	450.000	54033700	FIBRE ROPE 12 MM +-385M/25KG

R.....
Kilogram

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54033700
APPROVED ITEM NAME ROPE,FIBROUS
EQUIPMENT USED ON OHTE
STORES DESCRIPTION FIBRE ROPE 12 MM
3 STRAND.POLYPROPYLENE.
BRICK SYN. P.P. SPLITFILM-STK.
MIN. BREAKING STRENGTH 18 KN.
TO BE SUPPLIED IN 25 KG COILS.

00700	444	54000766	PARALLEL CLAMP 80/100-50 SQ MM*
-------	-----	----------	---------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54000766
SPECIFICATION NUMBER: CEE.0063.88/1.
BS 2874/LATEST I.S.O. 6509
S.A.B.S. 226/LATEST
DRAWING NUMBER: CEE-TNB-054 DATE 17.04.2007
CEE-TNB-055 DATE 17.04.2007
EQUIPMENT USED ON: OHTE
APPROVED ITEM NAME: SPLICE, CONDUCTOR
DESCRIPTION STORES: PARALLEL CLAMP.
100/80 TO 50 SQ MM.
COPPER-NICKEL-SILICON.
OR ALTERNATIVE MATERIAL
DEZINCIFICATION RESISTANT
BRASS (D.Z.R. BRASS)
TO BE TESTED IN ACCORDANCE
WITH SPECIFICATION BS 2874 OF
1986 (LATEST) TO CLAUSE 8 AND
APPENDIX "G" ALSO
SPECIFICATIONS S.A.B.S. 226
I.S.O. 6509 (TEST METHOD)

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 30

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
FULL DETAILS OF DESCRIPTION			
ITEM NUMBER	54006447		
APPROVED ITEM NAME	CLAMP,ELECTRICAL		
DRAWING NUMBER	CEE-TZ-1- 123 SHT 13&14/LATEST		
	CEE-TZ-7-123 SHEET 55		
EQUIPMENT USED ON	OHTE		
MAKERS PART NUMBER	143-088-001 BICC		
STORES DESCRIPTION	BALL SWIVEL CLAMP		
STORES DESCRIPTION	FOR STEADY ARM 26,9 MM OD TUBE		
00740	390	54032605	INSULATOR; TENSION, SILICON RUBBER
			R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

INSULATOR
TYPE TENSION
MATERIAL SILICON RUBBER
P/N: UNKNOWN ELECTRICAL MOULDED COMPONENTS
ITEM NUMBER 54032605; VANDAL PROOF; SQUARE TONGUE/ SQUARE
TONGUE COMPOSITE END CAPS; CREEPAGE PATH OF 1476 MM; 25 KVAC
SPECIFICATION: IEC 1109
DRAWING NO: BBB0281 DATE 2009.09.23 REV 4

00750	390	54011643	SWIVEL CLIP ASS.161MMSQTYPEF,G&H
			R..... Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54011643
APPROVED ITEM NAME CLAMP,ELECTRICAL
DRAWING NUMBER CEE-TN-264 DATE 01-07-1988
EQUIPMENT USED ON OHTE
SPECIFICATION NUMBER CEE-0063.88/1
STORES DESCRIPTION SWIVEL CLIP ASSEMBLY.
161 SQ MM
COPPER-NICKEL-SILICON.
FOR CRIMP-ON TYPE STEM.

DATE:

SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 33

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description	
CEE-TNB-066 DATE 1997.04.07				
EQUIPMENT USED ON		OHTE		
SPECIFICATION NUMBER		CEE.0063.88/1.		
STORES DESCRIPTION		SWIVEL CLIP ASSEMBLY.		
		107 SQ MM.		
		COPPER-NICKEL-SILICON.		
00820	328	54001189	LIGHTNING ARRESTER METAL OXIDE 3KV	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
MATERIAL NUMBER :		54001189		
APPROVED ITEM NAME :		ARRESTER,LIGHTNING		
DRAWING NUMBER :		CEE -TLE - 6 DATE 01.12.2000		
EQUIPMENT USED ON :		OHTE		
MAKERS PART NUMBER :		SBB4/10/G SURGE TECH		
SPECIFICATION NUMBER:		CEE-0240.04		
DESCRIPTION STORES :		LIGHTNING ARRESTER		
		METAL OXIDE TYPE RATED 10 KA		
		4,8 KV DC.		
		PEDESTAL MOUNTED, WITH ADAPTER		
		PLATE TO DRAWING CEE-TLE-6.		
		TO QUOTED PART NUMBER OR EQUAL.		
00830	324	54001420	CLEVIS SOCKET FOR PUSH-PULLOFF TUBE	R..... Each
Delivery Date: 21.12.2010				
FULL DETAILS OF DESCRIPTION				
ITEM NUMBER		54001420		
APPROVED ITEM NAME		CLEVIS SOCKET		
DRAWING NUMBER		CEE-TNB-40/LATEST		
EQUIPMENT USED ON		OHTE		
STORES DESCRIPTION		CLEVIS SOCKET		
		FOR PUSH-PULL OFF TUBE		
00840	310	54000944	TENSION SPLICE ALI. 500MM SQ.	R..... Each
Delivery Date: 21.12.2010				

DATE:

SIGNATURE OF TENDERER(S):

.....

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 34

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION MATERIAL NUMBER 054000944
 APPROVED ITEM NAME SPLICE, CONDUCTOR
 DRAWING NUMBER CEE-TNB-24
 EQUIPMENT USED ON 5400000
 5406700
 5406701
 SPECIFICATION NUMBER CEE.0038/83/LATEST
 STORES DESCRIPTION SPLICE, TENSION
 SUITABLE FOR 500 SQ MM
 STRANDED ALUMINIUM WIRE.
 USERS DESCRIPTION ALUMINIUM FEEDER WIRE

00850	308	54000907	PARALLEL CLAMP 250-250*
-------	-----	----------	-------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54000907
 APPROVED ITEM NAME SPLICE, CONDUCTOR
 SPECIFICATIONS CEE 0063.88/1.
 BS 2874 /LATEST. I.S.O. 6509
 S.A.B.S. 226/LATEST
 DRAWING NUMBER CEE-TNB-54 DATE 17.04.2007
 CEE.TNB-55 DATE 17.04.2007
 EQUIPMENT USED ON OHTE
 DESCRIPTION STORES PARALLEL CLAMP
 250 TO 250 SQ MM
 COPPER-NICKEL-SILICON.
 OR ALTERNATIVE MATERIAL
 DEZINCIFICATION RESISTANT
 BRASS. (D.Z.R. BRASS)
 TO BE TESTED IN ACCORDANCE
 WITH SPECIFICATION BS 2874 OF
 1986 (LATEST) TO CLAUSE 8 AND
 APPENDIX "G" ALSO
 SPECIFICATIONS S.A.B.S. 226
 I.S.O. 6509 (TEST METHOD)

00860	308	54001913	TURNBUCKLE 110MM M16 SCREWS
-------	-----	----------	-----------------------------

R.....
Each

Delivery Date: 21.12.2010

DATE: SIGNATURE OF TENDERER(S):

RFQ / TENDER

Tender No: VAR-6547 Page
Date : 24.08.2010 35

BOARD LIST
TRANSNET FREIGHT RAIL
PROCUREMENT DEPARTMENT

Item	Qty	Material	Description
------	-----	----------	-------------

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54001913
APPROVED ITEM NAME: TURNBUCKLE
DRAWING NUMBER: CEE-TNB-31 DATE 21-06-2006
EQUIPMENT USED ON: OHTE
SPECIFICATION NUMBER: BS 4429
DESCRIPTION STORES: TURNBUCKLE
DROP-FORGED 110 MM TAKE-UP,
M16 SCREWS.EYE TO EYE.
COMPLETE WITH LOCKNUT
HOT DIPPED GALVANISED
TO SPEC. SANS 121 DATE 2000.

00870	296	54010573	SPLICING KIT FOR 500 MMSQ XLPE CABLE
-------	-----	----------	--------------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

MATERIAL NUMBER 54010573
APPROVED ITEM NAME SP LICING KIT,POWER CABLE
EQUIPMENT USED ON OHTE
MAKERS PART NUMBER SMOE 743(MOD-PRM) RAYTECH
JHJ 3.3/1X4DC JOINTMASTER
STORES DESCRIPTION IN LINE JOINT, 500 MM.SQ.
HEAT SHRINKABLE COMPLETE WITH
COPPER EARTH STRAP FERRULE &
SLEEVES.
SINGLE CORE 3,3 KV. DC.
XPLE CABLE
TO QUOTED PART NUMBERS OR EQUAL

00880	274	54033696	CANTILEVER ARC HORN ASSEMBLY 3 KV
-------	-----	----------	-----------------------------------

R.....
Each

Delivery Date: 21.12.2010

FULL DETAILS OF DESCRIPTION

ITEM NUMBER 54033696
APPROVED ITEM NAME ARRESTER,ELECTRICAL SURGE
DRAWING NUMBER BBB 2141
EQUIPMENT USED ON OHTE

DATE:

SIGNATURE OF TENDERER(S):

.....

